



SEWAGE SYSTEM INSTALLATION REPORT

U/3/00
FILE NUMBER

REPORT


DATE 06-05-19

INSTALLED BY: Inkett Construction Ltd.

Work authorized by Site Inspection Report for a sewage system has been satisfactorily completed and includes:

- Septic Tank/Holding Tank of working capacity of 4500 litres constructed of steel/concrete/fibreglass; Manufacturer BcP
- Distribution Pipe: Type 3" PVC; Absorption Trench System ☒
- Filter Bed System ☐; Filter Bed Area _____ sq. m.; Contact Area _____ sq. m.
- Total 106 Lineal Metres in 7 runs of 15 metres and fed by gravity ☐; Siphon ☐; or Pump ☒
- Size of System based on 3 bedrooms and/or 22 fixture units. Commercial details _____
- Structure over 200 M² - YES ☐ NO ☒
- Other _____

Actual location and orientation of components of sewage system are shown hereunder ☒ or as outlined on the Site Inspection Report For A Sewage System form ☐

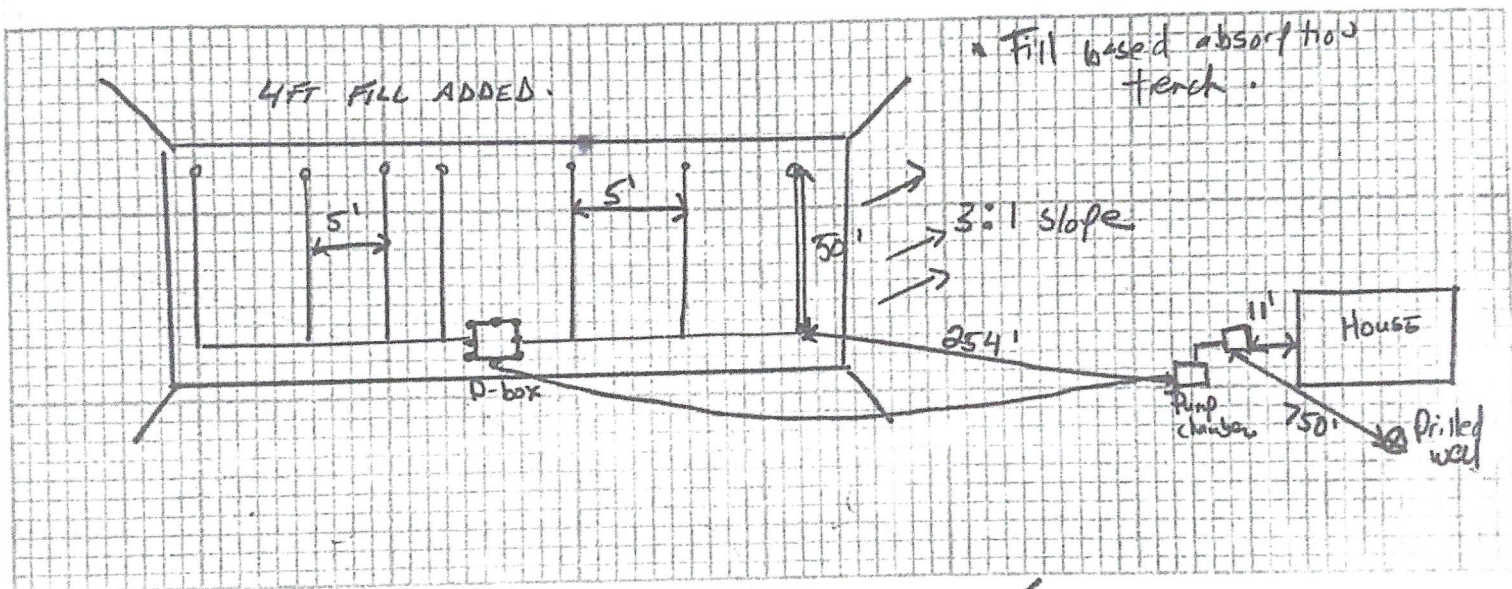

The following work remains to be completed: Backfill system and sod or seed ☒. Stabilize all sloped surfaces ☒. Finish grading to shed run-off and divert water around leaching bed ☐. Other _____

INSTALLATION REPORT

Under the Building Code Act and regulations and subject to the limitations thereof, a permit is hereby issued to _____

For the use and operation of the Class 4 Sewage System Installed / Altered under Site Inspection Report # _____

Such system being located on Lot 13 Conc 9 Plan _____ Sub. lot 6,7,8,9 Roll No. _____


Township / Municipality VERULAM County VICTORIA

Inspected and Recommended by G. Stulig
(Appointed Inspector - Part 8)

Date 06-05-19 Issued A. Borm
(Designated Sewage Inspector - Part 8)

NOTE: No change can be made to any building(s) or structures in connection with which this sewage system is used, if the operation or effectiveness of the sewage system will be affected by the change, unless a Site Inspection Report is obtained.

UTM 17 2 69 3 57 10 E

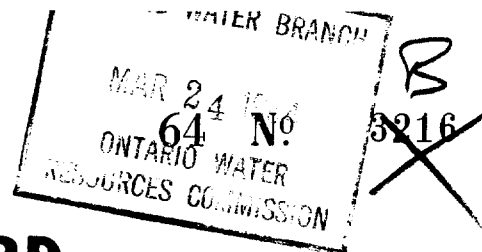

Co. 9 R 149 3 2 7 3 5 N

The Ontario Water Resources Commission Act

Elev. 60 1 9 R 10 8 4 0

WATER WELL RECORD

Basin 24 Victoria

County District

Con. 12 13 12

Lot

Township, Village, Town or City

Venham

Date completed

17

(day)

Feb.

month

1964

year

Address

Fenelon Falls, R.R. #3

Casing and Screen Record

Inside diameter of casing 6 1/4"

Total length of casing 21'

Type of screen no screen.

Length of screen —

Depth to top of screen —

Diameter of finished hole 6 1/4"

Pumping Test

Static level 4'

Test-pumping rate 36 G.P.M.

Pumping level 4'

Duration of test pumping 2 hrs.

Water clear or cloudy at end of test clear

Recommended pumping rate 10 G.P.M.

with pump setting of 15' feet below ground surface

Well Log

Water Record

Overburden and Bedrock Record

From ft.

To ft.

Depth(s) at which water(s) found

Kind of water (fresh, salty, sulphur)

Top soil

0

2'

18'-21'

fresh

yellow clay + stones

2'

12'

coarse sand + gravel

12'

21'

For what purpose(s) is the water to be used?

house + cottage

Is well on upland, in valley, or on hillside?

upland

Drilling or Boring Firm

J. F. Henderson

Address

103 Elgin St. Lindsay.

Licence Number

#1203

Name of Driller or Borer

F. G. Tang.

Address

109 Venham Rd. Lindsay.

Date

Mar. 17/64.

J. F. Henderson

(Signature of Licensed Drilling or Boring Contractor)

File 7 15M-60-4138

OWRC COPY

Location of Well

In diagram below show distances of well from road and lot line. Indicate north by arrow.

