

SEWAGE SYSTEM INSPECTION REPORT AND USE PERMIT

5-87-89  
FILE NUMBER

REPORT


INSTALLED BY: G. Shepherd

DATE: Dec 15/90

Work authorized by certificate of approval has been satisfactorily completed and includes:

- ~~Septic Tank~~ Holding Tank of working capacity of 4500 litres constructed of steel/concrete/fiberglass on site ☐ or prefabricated ☒ to serve 4 bedrooms
- Distribution Pipe: Type PVC ☒; Clay Tile ☐; Other ☐; Absorption Trench System ☐  
Filter Bed System ☒; Filter Bed Area 38.8 sq. m.; Contact Area 7 sq. m.  
Total 22.86 Lineal Metres in 5 runs of 4.5 metres and fed by gravity ☒; Siphon ☐; or Pump ☐.
- Other Details \_\_\_\_\_

Actual location and orientation of components of sewage system are as shown hereunder ☐ or as outlined on the Certificate of Approval form ☐

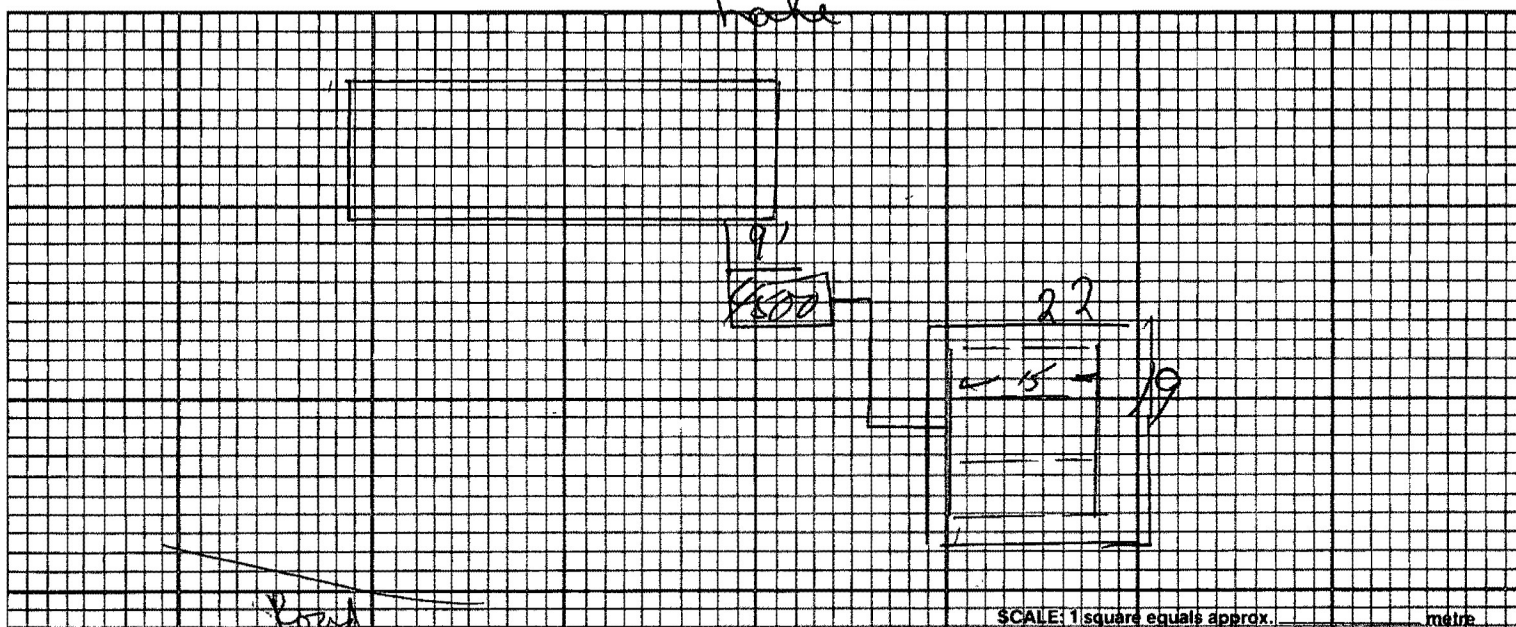

The following work remains to be completed: Backfill system and sod or seed ☒; Stabilize all sloped surfaces ☐; Finish grading to shed run-off and divert water around leaching bed ☐; Other \_\_\_\_\_

USE PERMIT

Under section 67 of the Environmental Protection Act, 1980 and regulations and subject to the limitations thereof, a permit is hereby issued to

for the use and operation of the Class Sewage System Installed/Altered under Certificate of Approval # 5-87-89

such system being located on Lot 40 Scot Rap Conc. 571 Plan 5 Sub. lot 5

Township/Municipality Somersville County Victoria

Inspected and Recommended by John McRae

DATE Dec 15, 1990

Issued [Signature]

(Director)

NOTE: Section 64 of the Act provides that no change can be made to any building(s) or structures in connection with which this sewage system is used, if the operation or effectiveness of the sewage system will be affected by the change, unless a Certificate of Approval is obtained.