

HALIBURTON, KAWARTHA, PINE RIDGE DISTRICT HEALTH UNIT

SEWAGE SYSTEM INSPECTION REPORT AND USE PERMIT

S-53-86

FILE NUMBER

REPORT


INSTALLED BY: Dave Graham 454-3707

DATE: 86/08/28

Work authorized by certificate of approval has been satisfactorily completed and includes:

- A. Septic Tank/Holding Tank of working capacity of 4500 NPEP litres constructed of steel/concrete/fiberglass on site ☐ or prefabricated ☒ to serve 4 bedrooms
- B. Distribution Pipe: Type - PVC ☒, Clay Tile ☐, Other ☐; Absorption Trench System ☐; Filter Bed System ☒; Total 6 lineal meters in 6 runs of 6 meters and fed by gravity ☐; Siphon ☐ or Pump ☐.
- C. Other Details

Actual location and orientation of components of sewage system are as shown hereunder ☐ or as outlined on the Certificate of Approval form ☐

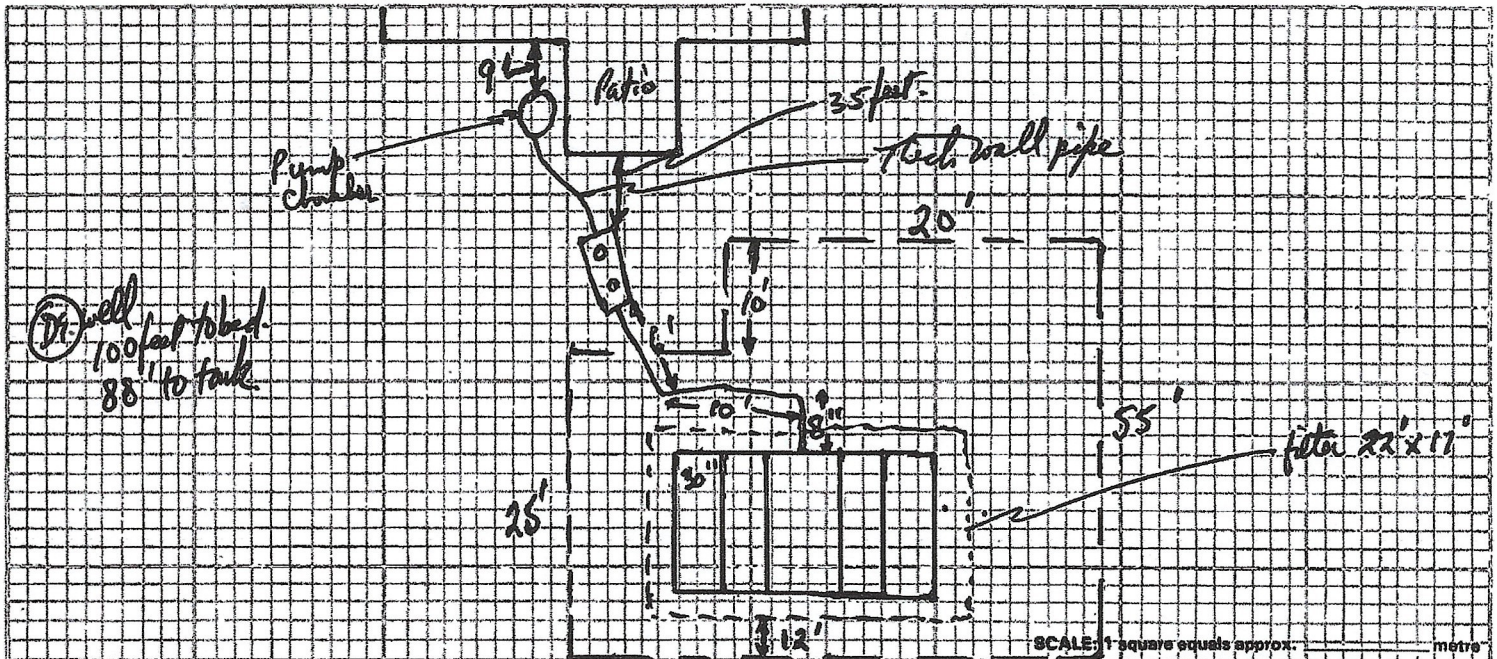

The following work remains to be completed: Backfill system and sod or seed ☐; Stabilize all sloped surfaces ☐; Finish grading to shed run-off and divert water around leaching bed ☐; Other

USE PERMIT

Under section 67 of the Environmental Protection Act, 1980 and regulations and subject to the limitations thereof, a permit is hereby issued to

Mr. Palmer

for the use and operation of the Class 4 Sewage System Installed/Altered under Certificate of Approval #

such system being located on Lot 26 Conc. Front Page Man 424 Sub. lot 3

Township/Municipality Sovereignville County Victoria

Inspected and Recommended by TDWayer

DATE 86/08/28

Issued

Robert A. Wicks
(Director)

NOTE: Section 64 of the Act provides that no change can be made to any building(s) or structures in connection with which this sewage system is used, if the operation or effectiveness of the sewage system will be affected by the change, unless a Certificate of Approval is obtained.