



# Sewage System Installation Permit

File No. 20140408  
Roll No. 1651 21006007602

Sewage System Installation by: MARK GRIFFIN CONST. Date: JUNE 10, 2014.

## Approved Installation of the Sewage System includes:

☒ New ☐ Repair/Alteration ☐ Tank Replacement ☐ Bed Replacement  
☐ Class 2 or 3 System: Size: \_\_\_\_\_ m<sup>2</sup> Configured As: Length \_\_\_\_\_ m x Width \_\_\_\_\_ m x Height \_\_\_\_\_ m  
Wall Structure: \_\_\_\_\_ Type of Cover: \_\_\_\_\_

☐ Class 5 System: Holding Tank: \_\_\_\_\_ L ☐ Audible & Visual Alarm Observed

## ☒ Class 4 System:

☒ Septic Tank: Working Capacity 4500 L constructed of concrete/fiberglass/plastic; Manufacturer: BCP

☒ Distribution System: PVC; fed by ☐ Gravity ☒ Pump ☐ Siphon

## ☐ Conventional Trench System:

Total \_\_\_\_\_ Lineal Metres in \_\_\_\_\_ runs of \_\_\_\_\_ m

## ☐ Type A Dispersal Bed/Area Bed:

Stone Area \_\_\_\_\_ m<sup>2</sup> Sand Area \_\_\_\_\_ m<sup>2</sup>

## ☒ Filter Bed:

Filter Bed Area 28.2 m<sup>2</sup> # of Pods 1

## ☐ Type B Dispersal Bed:

DBA \_\_\_\_\_ m<sup>2</sup> Linear Loading Rate \_\_\_\_\_ m

Expanded Contact Area 115.3 m<sup>2</sup>

Configured As: \_\_\_\_\_ m x \_\_\_\_\_ m

☒ Loading Rate Area: 350.8 m<sup>2</sup> Imported ☐ Native ☒ 15 metre Mantle ☒ Constructed ☐ Native ☐ Not Applicable

☒ Height Raised Above Original Grade: 0.6m m ☐ Other: \_\_\_\_\_

## Sewage System Installation is based on:


Total Daily Sewage Flow: 2100 L/day

☒ No. of Bedrooms: 4; Total No. of Fixture Units 22; Total Living Space 167 m<sup>2</sup>

☐ Commercial: \_\_\_\_\_

☒ Sewage System is not designed to receive backwash water from a water treatment device.

@ well > 30m TO PROPERTY LINE

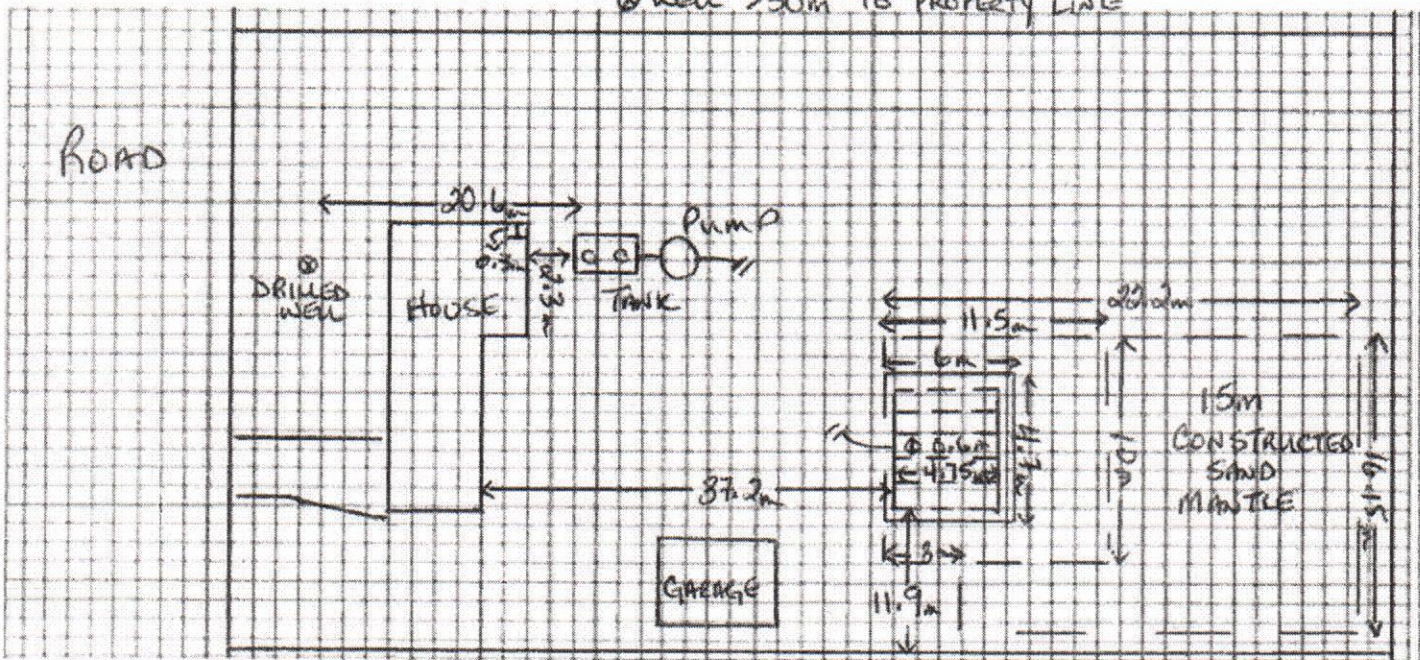

Under the Building Code Act, Ontario Regulation 332/12 as amended and subject to the limitations thereof, an Installation Permit is hereby issued to: RANDY PUDDISTER for the use and operation of the above-noted sewage system installed and inspected at: 33 NORTHLINE RD also known as Lot PT. 24 Concession 11 Plan 57R1494 Sublot/Part: N/A in the City of Kawartha Lakes.

Inspected and Issued By: ARZHUJ L Date: JUNE 13, 2014

Note: No change can be made to any building(s) or structures in connection with which this sewage system is used, if the operation or maintenance of the sewage system will be effected, unless approval is obtained.