

HALIBURTON, KAWARTHA, PINE RIDGE DISTRICT HEALTH UNIT

SEWAGE SYSTEM INSPECTION REPORT AND USE PERMIT

By-31-81
FILE NUMBER

REPORT


INSTALLED BY: Carl Brentnall

DATE: Sept 30/82

Work authorized by certificate of approval has been satisfactorily completed and includes:

- A. Septic Tank/Holding Tank of working capacity of 4500 litres constructed of steel/concrete/fiberglass on site ☐ or prefabricated ☒ to serve 3 bedrooms
- B. Leaching Bed of total 61 lineal metres of PVC distribution pipe laid in 4 runs of 50' 15 metres and fed by Gravity/Syphon/Pump. (P.V.C., Drain Tile, etc.)
- C. Other Details _____

Actual location and orientation of components of sewage system are as shown hereunder ☐ or as outlined on the Certificate of Approval form ☐

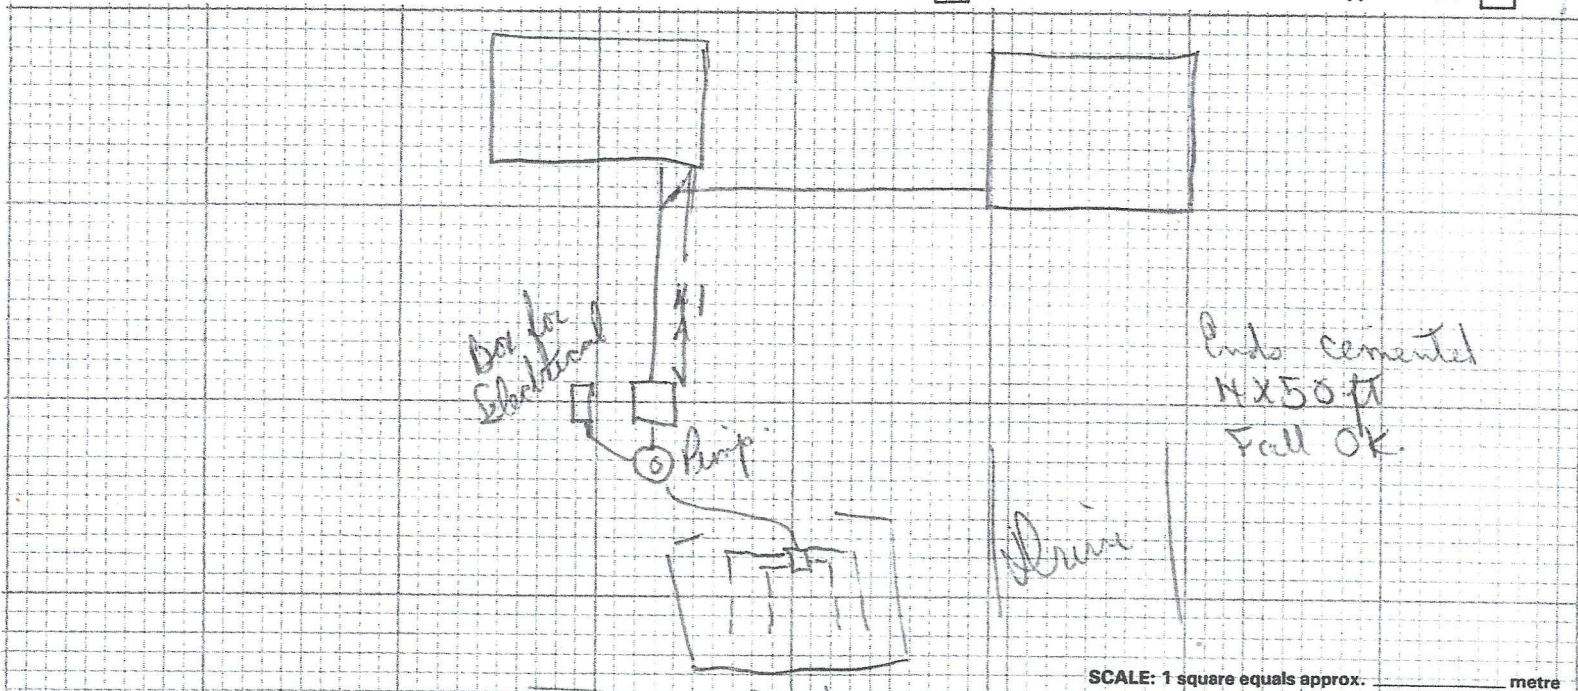

The following work remains to be completed: Backfill system and sod or seed ☐ ; Stabilize all sloped surfaces ☐ ; Finish grading to shed run-off and divert water around leaching bed ☐ ; Other _____

USE PERMIT

Under section 59A of the Environmental Protection Act, 1971 and regulations and subject to the limitations thereof a permit is hereby granted to

Mr & Mrs Wim Holland
for the use and operation of the Class 4 Sewage System Installed/Altered under Certificate of Approval # Be-31-81

such system being located on Lot 187 Conc Beck Plan 187 Sub. lot 97

Township/Municipality Beck County Victoria

Inspected and Recommended by John

Dated this 30 Day of Sept 19 82 Issued R. H. H. H.

(Director)