KAWARTHA LAKES

Sewage System Installation Permit

File No. 20141179
Roll No. 1651 210 030 4730

Sewage System Installation by: YOUNG'S CONSTRUCTION **Date:** OCTOBER 16, 2014

Approved Installation of the Sewage System includes:

☒New ☐Repair/Alteration ☐Tank Replacement ☐Bed Replacement

☐**Class 2 or 3 System**: Size: _____ m^2 Configured As: Length _____ m x Width _____ m x Height _____ m
Wall Structure: _____ Type of Cover: _____

☐**Class 5 System**: Holding Tank: _____ L ☐Audible & Visual Alarm Observed

☒**Class 4 System**:

☐Septic Tank: Working Capacity 4500 L constructed of concrete/fiberglass/plastic; Manufacturer: ASMTEC BCP

☒Distribution System: ARC 18 ; fed by ☐Gravity ☒Pump ☐Siphon

☐Conventional Trench System: Total _____ Lineal Metres in _____ runs of _____ m	☐Type A Dispersal Bed/Area Bed: Stone Area _____ m^2 Sand Area _____ m^2
☒Filter Bed: Filter Bed Area 28.4 m^2 # of Pods 1 Expanded Contact Area 106 m^2	☐Type B Dispersal Bed: DBA _____ m^2 Linear Loading Rate _____ m Configured As: _____ m x _____ m

☒Loading Rate Area: 334.45 m ☒Imported ☐Native ☒15 metre Mantle ☒Constructed ☐Native ☐Not Applicable

☒Height Raised Above Original Grade: 0.75 m ☐Other: _____

Sewage System Installation is based on:

Total Daily Sewage Flow: 2000 L/day

☒ No. of Bedrooms: 4 ; Total No. of Fixture Units <20 ; Total Living Space 139.35 m^2

☐ Commercial: _____

☒ Sewage System is not designed to receive backwash water from a water treatment device.

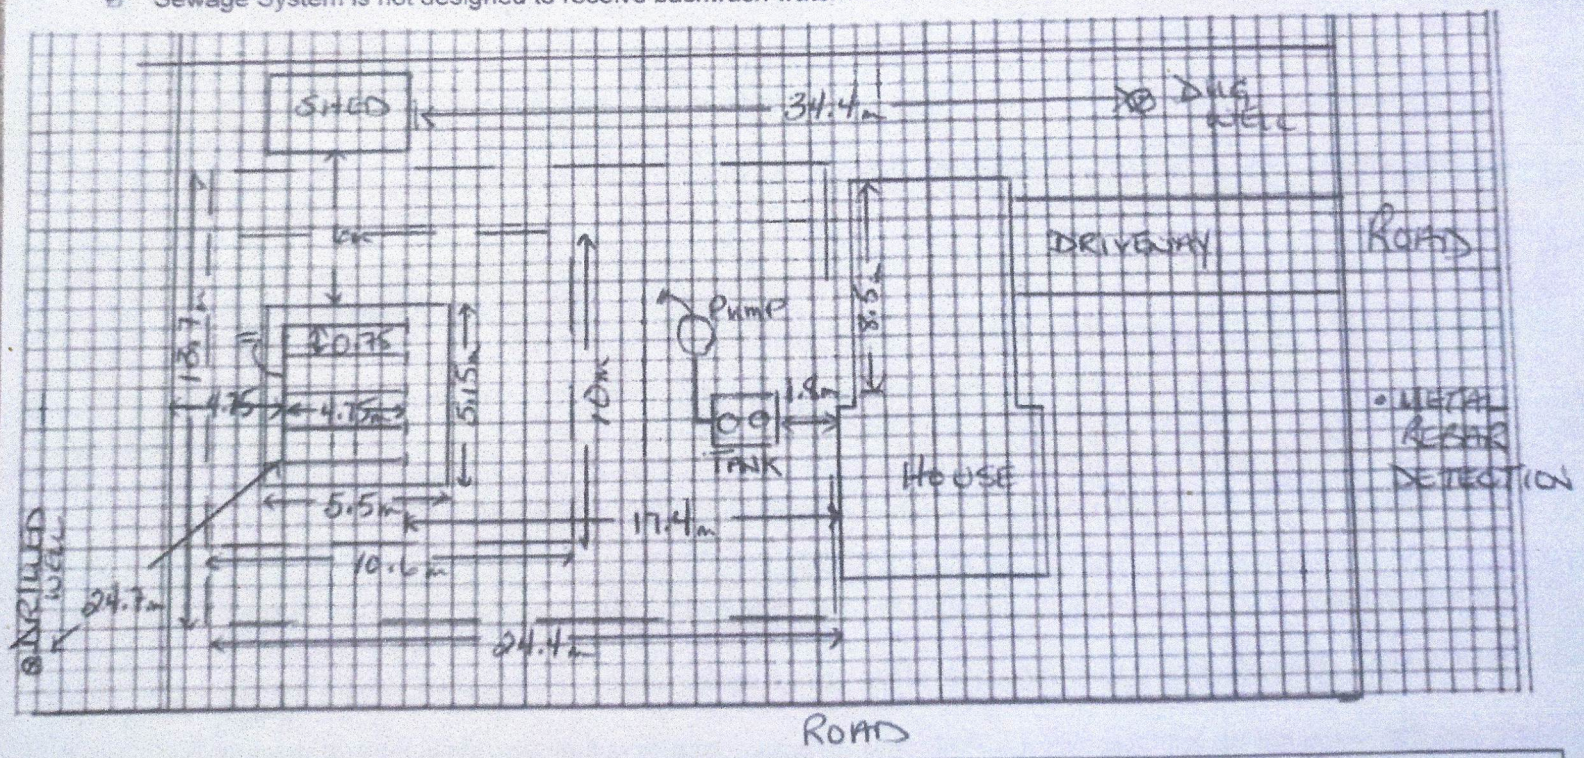

Under the Building Code Act, Ontario Regulation 332/12 as amended and subject to the limitations thereof, an Installation Permit is hereby issued to: XXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXX for the use and operation of the above-noted sewage system installed and inspected at: 519 LONG BEACH ROAD also known as Lot PT. 11 Concession 8 Plan 505 Sublot/Part: 4 in the City of Kawartha Lakes.

Inspected and Issued By: A Chhirsl Date: OCTOBER 16, 2014

Note: No change can be made to any building(s) or structures in connection with which this sewage system is used, if the operation or maintenance of the sewage system will be affected, unless approval is obtained.