



SEWAGE SYSTEM INSTALLATION REPORT

S-31-03

FILE NUMBER

REPORT


DATE OCT 27, 03

INSTALLED BY: Sheppard Environmental Services

Work authorized by Site Inspection Report for a sewage system has been satisfactorily completed and includes:

- Septic Tank Holding Tank of working capacity of 4500 litres constructed of steel/concrete/fibreglass; Manufacturer B&P
- Distribution Pipe: Type Absorption Trench System ☐
- Filter Bed System ☐ Filter Bed Area 45.9 sq. m.; Contact Area 74+ sq. m.
- Total 549 Linear Metres in 6 runs of 9.1 metres and fed by gravity ☐; Siphon ☐; or Pump ☐
- Size of System based on 3+1 bedrooms and/or 120 fixture units. Commercial details Replacement system.
- Area of Building: 1200 m²
- Other

Actual location and orientation of components of sewage system are shown hereunder ☐ or as outlined on the Site Inspection Report For A Sewage System form ☐

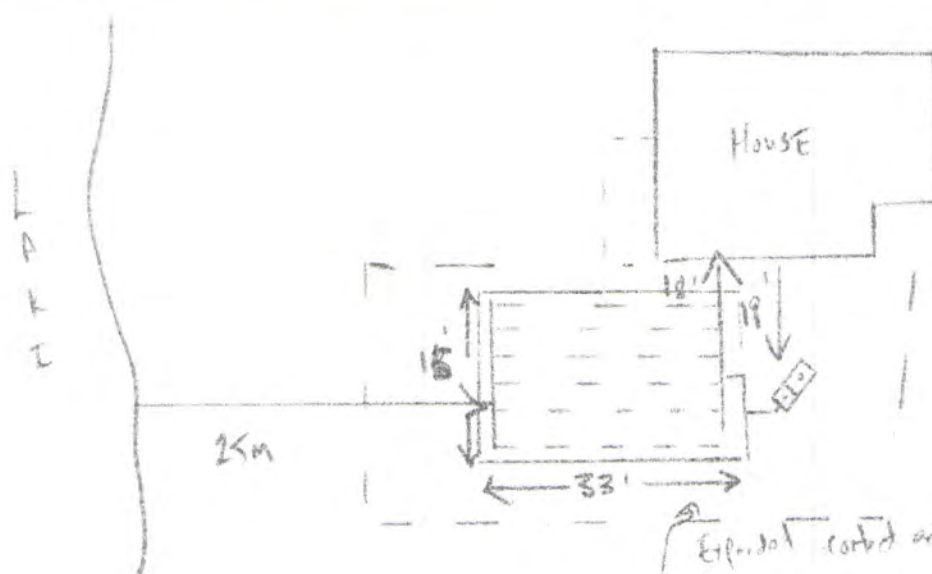

- Raised Altered at 30' centres
- Stone layer clearances satisfactory
- Heads level.

The following work remains to be completed: Backfill system and sod or seed ☒; Stabilize all sloped surfaces ☒; Finish grading to shed run-off and divert water around leaching bed ☒. Other

INSTALLATION REPORT

Under the Building Code Act and regulations and subject to the limitations thereof, a permit is hereby issued to

Kenneth H. A.

For the use and operation of the Class 4 Sewage System Installed / Altered under Site Inspection Report #

S-31-03

Such system being located on Lot P114 Conc. 1 Plan 363 Sub. lot 24 Roll No.

Township / County / City C.K.L. GLEN TWP. SHEPPARDVILLE

Emergency # 911 87 Wainwright Dr.

Inspected and Recommended by G. J. A.
(Appointed Inspector - Part 8)

Date OCT 27, 03

Issued G. J. A.

(Designated Sewage Inspector - Part 8)

NOTE: No change can be made to any building(s) or structures in connection with which this sewage system is used, if the operation or effectiveness of the sewage system will be affected by the change, unless a Site Inspection Report is obtained.



SHEPHERD ENVIRONMENTAL SERVICES

6798 Hwy 35, P.O. Box 68
Coboconk, Ontario K0M 1K0

Telephone: 705-454-3744 • 705-454-3627
705-887-1503 • 705-286-1178
Fax: 705-454-8700

CUSTOMER:

OLSZANIECKI, MR. RICHARD
17 QUEENSBOROUGH CRES.
TORONTO ON M9R 1A1

DIRECTIONS:

87 WOODWORTH DR.
OFF PINERY RD.
ON 4 MILE LK.

INV. NO.

00000974 11

DATE:

Jul-31-17

CUST. NO.

010454

(416) 525-6463 Ext.

TERMS: **PAYABLE ON RECEIPT**
(We accept VISA • M/C • DEBIT)
HST # R104831243

ITEM NUMBER	DESCRIPTION	AMOUNT												
SEPTIC5-01	PUMPING SEPTIC TANK	172.57												
<table><tr><td>ITEM</td><td>CONDITION</td></tr><tr><td>INLET BAFFLE:</td><td>GOOD POOR</td></tr><tr><td>OUTLET BAFFLE:</td><td>GOOD POOR</td></tr><tr><td>SEWAGE LEVEL:</td><td>GOOD TOO HIGH</td></tr><tr><td>MANHOLE CONDITION:</td><td>GOOD POOR</td></tr><tr><td colspan="2">SIGNATURE: <i>Andrew Shepherd</i></td></tr></table> PAID JUL 31 2017 m/c Thank You www.shepherdenvironmental.ca HST			ITEM	CONDITION	INLET BAFFLE:	GOOD POOR	OUTLET BAFFLE:	GOOD POOR	SEWAGE LEVEL:	GOOD TOO HIGH	MANHOLE CONDITION:	GOOD POOR	SIGNATURE: <i>Andrew Shepherd</i>	
ITEM	CONDITION													
INLET BAFFLE:	GOOD POOR													
OUTLET BAFFLE:	GOOD POOR													
SEWAGE LEVEL:	GOOD TOO HIGH													
MANHOLE CONDITION:	GOOD POOR													
SIGNATURE: <i>Andrew Shepherd</i>														
COMMENTS:		TOTAL:												
Material on site pertaining to this invoice remains the property of Shepherd Environmental Services until paid in full. Work done close to trees, flower beds, patios, sidewalks, etc. done at customer's risk only. 2% INTEREST CHARGED PER MONTH ON ACCOUNTS OVER 30 DAYS.		\$195.00												
PAYMENT METHOD:														



CUSTOMER COPY

INVOICE

DRIVER: _____